

CLASS 1 BACKFILL: NATIVE OR COMMON MATERIAL WITH A 2" MIN. CROWN, COMPACTED TO 95% T-99.

CLASS 2 BACKFILL: NATIVE OR COMMON MATERIAL COMPACTED IN 8" LIFTS, TO 95% T-180 W/ 2" MIN. CROWN.

CLASS 3 BACKFILL: 1"-MINUS CRUSHED AGGREGATE, COMPACTED IN 8" LIFTS TO 95% AASHTO T-180.


CLASS 4 BACKFILL: CONTROLLED DENSITY FILL (CDF).

WATER, SEWER, OR STORM PIPE MATERIAL AS SPECIFIED.

BEDDING AND PIPE ZONE SHALL BE TYPE A, B, C, OR D AS SPECIFIED, SEE STANDARD DETAIL 3800-2.

NOTES:

1. ENGINEER WILL CONSIDER ADJUSTING USUAL TRENCH WIDTH TO ACCOMMODATE CONDITION ENCOUNTERED.
2. REFERENCE TECHNICAL SPEC. SECTION 3800.
3. FOR HMA TRENCH CAP SURFACE REPLACEMENT SEE DETAIL 3800-5.

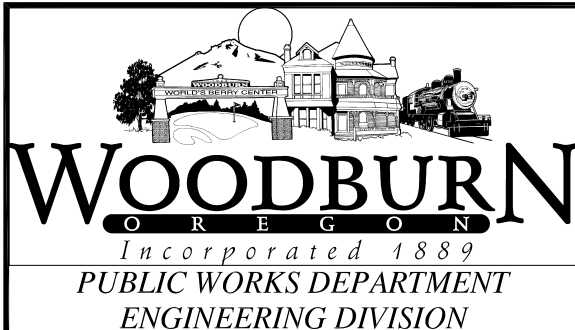

**PIPE TRENCH  
BACKFILL**

REV: DEC. 2007

SCALE: NTS

DET No.

**3800-1**