


BROOM FINISH SURFACE IN DIRECTION SHOWN AND PROVIDE 3" EDGE SHINE.

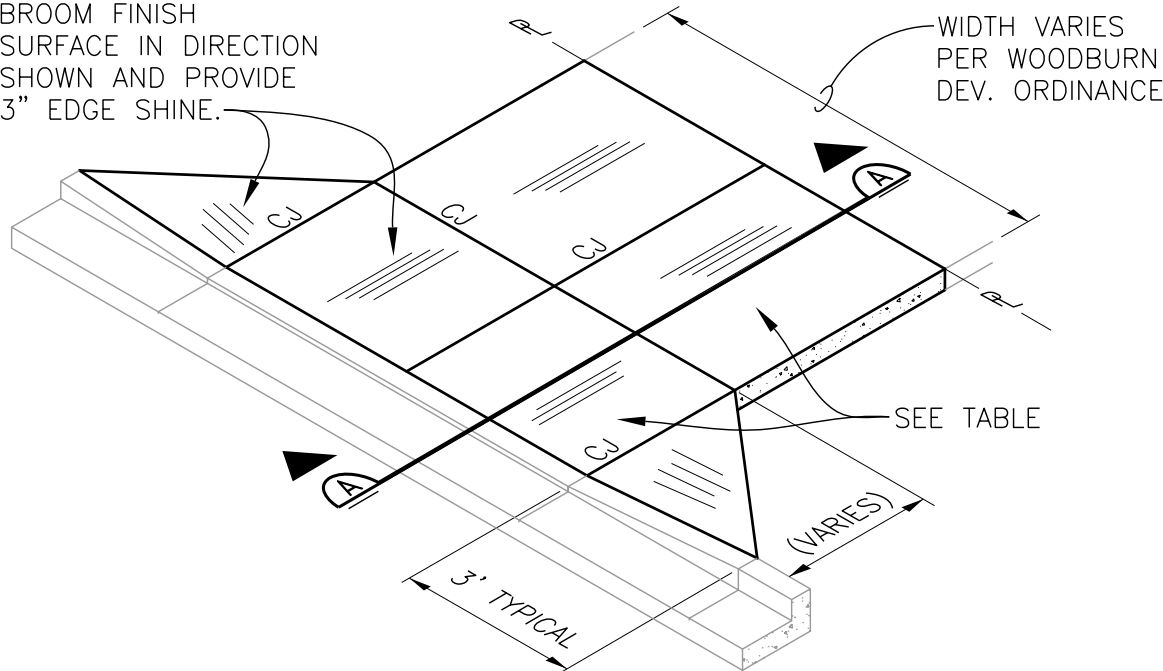


CONCRETE/AGGREGATE BASE THICKNESS AND REINFORCEMENT.

USE	CONC.	1"-MINUS CRUSHED AGGREGATE	REBAR
SINGLE FAMILY RESIDENTIAL	6"	4"	NONE
ALL OTHER	8"	6"	No.4 @ 12"O.C. EACH WAY


SEE TABLE

FOR CURB SEE DETAIL 4100-4 OR 4100-5

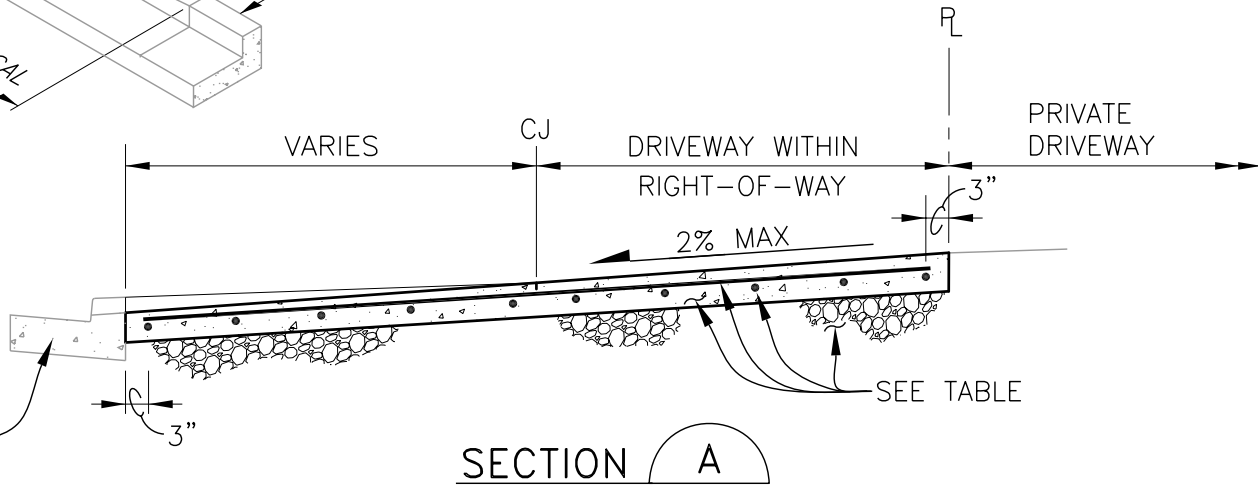

**NOTES:**

1. REFERENCE TECHNICAL SPEC. SECTION 4150.
2. EXPANSION JOINTS (EJ) SHALL BE 1/2" AC IMPREGNATED JOINT FILLER AT ALL DISSIMILAR VERTICAL SURFACES.
3. MATERIAL - 3500 PSI CONCRETE AT 28 DAYS.

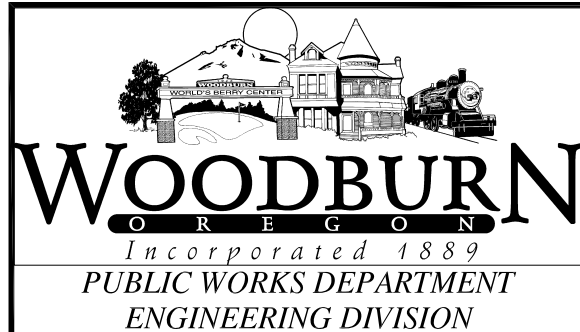

**DRIVEWAY APPROACH**

REV: DEC. 2007

SCALE: NTS

DET No.

**4150-1**